


# RE-ISSUE MONTHLY TRUE-UP TEST APRIL 2015 RESULTS

Due to severe weather in April leading to flooding of the ARTC network, Force Majeure was declared and lost paths were captured as an Availability Exception pursuant to clause 3.6 of the Access Holder Agreement. ARTC calculated the availability exceptions using a methodology where the Monthly BPU for each Access Holder calculated as Daily BPD, and then multiplied by the number of days the load point was available for the month, with the view to reissuing the TUT at a later point with more accurate data from the HVCCC Planning Process.

Since the initial results were published in April we have received data from the HVCCC advising of the planned volumes for 21 April 2015 and the CAP for the period until 30 April 2015. ARTC has recalculated the availability exceptions utilising planned volumes until date the respective load point returned to service.

**March 2016 - The system True Up Test for each Pricing Zone for April has again been withdrawn and re-published to correct errors. The updates did not result in any system availability shortfall for the period.**

Pricing Zone 1		
	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		2,100
Adhocs - Actual and Deemed		9
Monthly Tolerance Cap		184
Actual Maintenance Requirement		436
Actual System Losses - ARTC		8
Lesser Of Forecast/Actual Other Loss		51
Utilisation By Non-Coal Trains		167
Less Availability Exceptions	370	
Network Path Capability	3,630	
System Availability Surplus		1,045

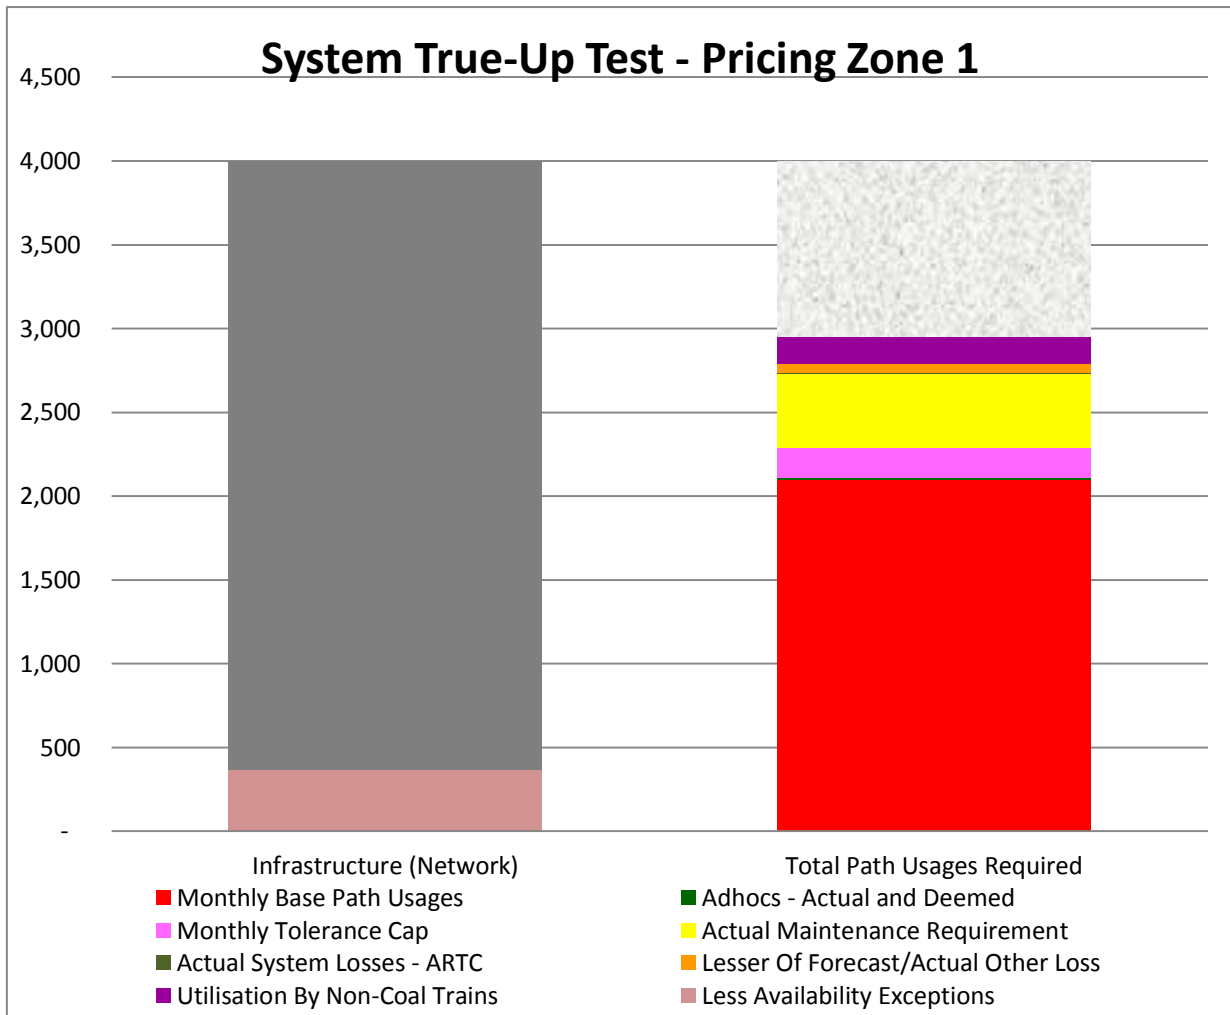


## RE-ISSUE MONTHLY TRUE-UP TEST APRIL 2015 RESULTS

Due to severe weather in April leading to flooding of the ARTC network, Force Majeure was declared and lost paths were captured as an Availability Exception pursuant to clause 3.6 of the Access Holder Agreement. ARTC calculated the availability exceptions using a methodology where the Monthly BPU for each Access Holder calculated as Daily BPD, and then multiplied by the number of days the load point was available for the month, with the view to reissuing the TUT at a later point with more accurate data from the HVCCC Planning Process.

Since the initial results were published in April we have received data from the HVCCC advising of the planned volumes for 21 April 2015 and the CAP for the period until 30 April 2015. ARTC has recalculated the availability exceptions utilising planned volumes until date the respective load point returned to service.

**March 2016 - The system True Up Test for each Pricing Zone for April has again been withdrawn and re-published to correct errors. The updates did not result in any system availability shortfall for the period.**

Pricing Zone 2		
	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		427
Adhocs - Actual and Deemed		-
Monthly Tolerance Cap		56
Actual Maintenance Requirement		-
Actual System Losses - ARTC		5
Lesser Of Forecast/Actual Other Loss		35
Utilisation By Non-Coal Trains		17
Less Availability Exceptions	127	
Network Path Capability	690	
System Availability Surplus		277

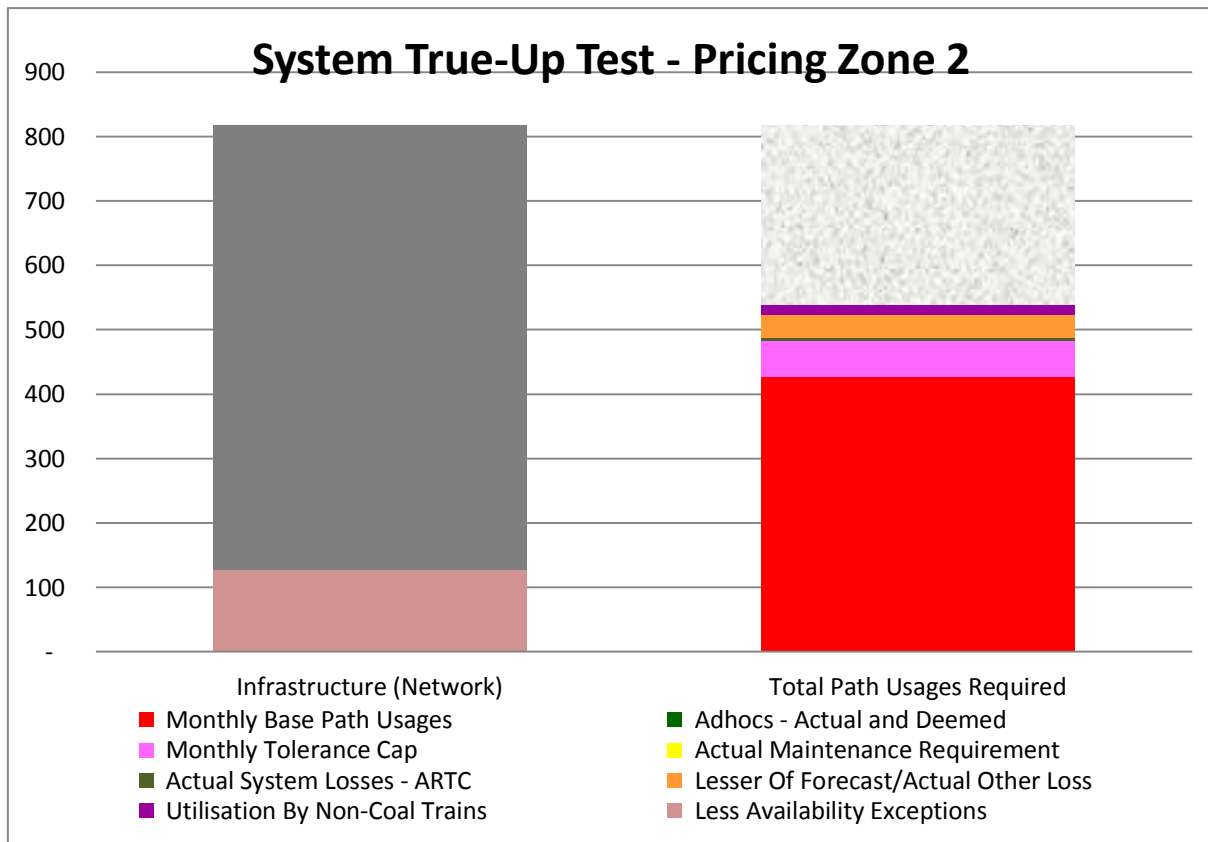

ARTC considers publishing of system true-up test results for Pricing Zone 3 in aggregation will disclose confidential information about an individual access holder. In accordance with Clause 2.7(a) of Schedule 2 of Access Holder Agreements ARTC is not publishing Pricing Zone 3. There is no System Availability Shortfall in Pricing Zone 3.