


MONTHLY TRUE-UP TEST AUGUST 2014 RESULTS

The system true up test for each Pricing Zone for August has been withdrawn and re-published to correct an error. This update did not result in any System Availability Shortfall for the period.

Pricing Zone 1		
	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		1,960
Adhocs - Actual and Deemed		12
Monthly Tolerance Cap		150
Actual Maintenance Requirement		222
Actual System Losses - ARTC		10
Lesser Of Forecast/Actual Other Loss		77
Utilisation By Non-Coal Trains		329
Less Availability Exceptions	13	-
Network Path Capability	3,410	-
System Availability Surplus		663

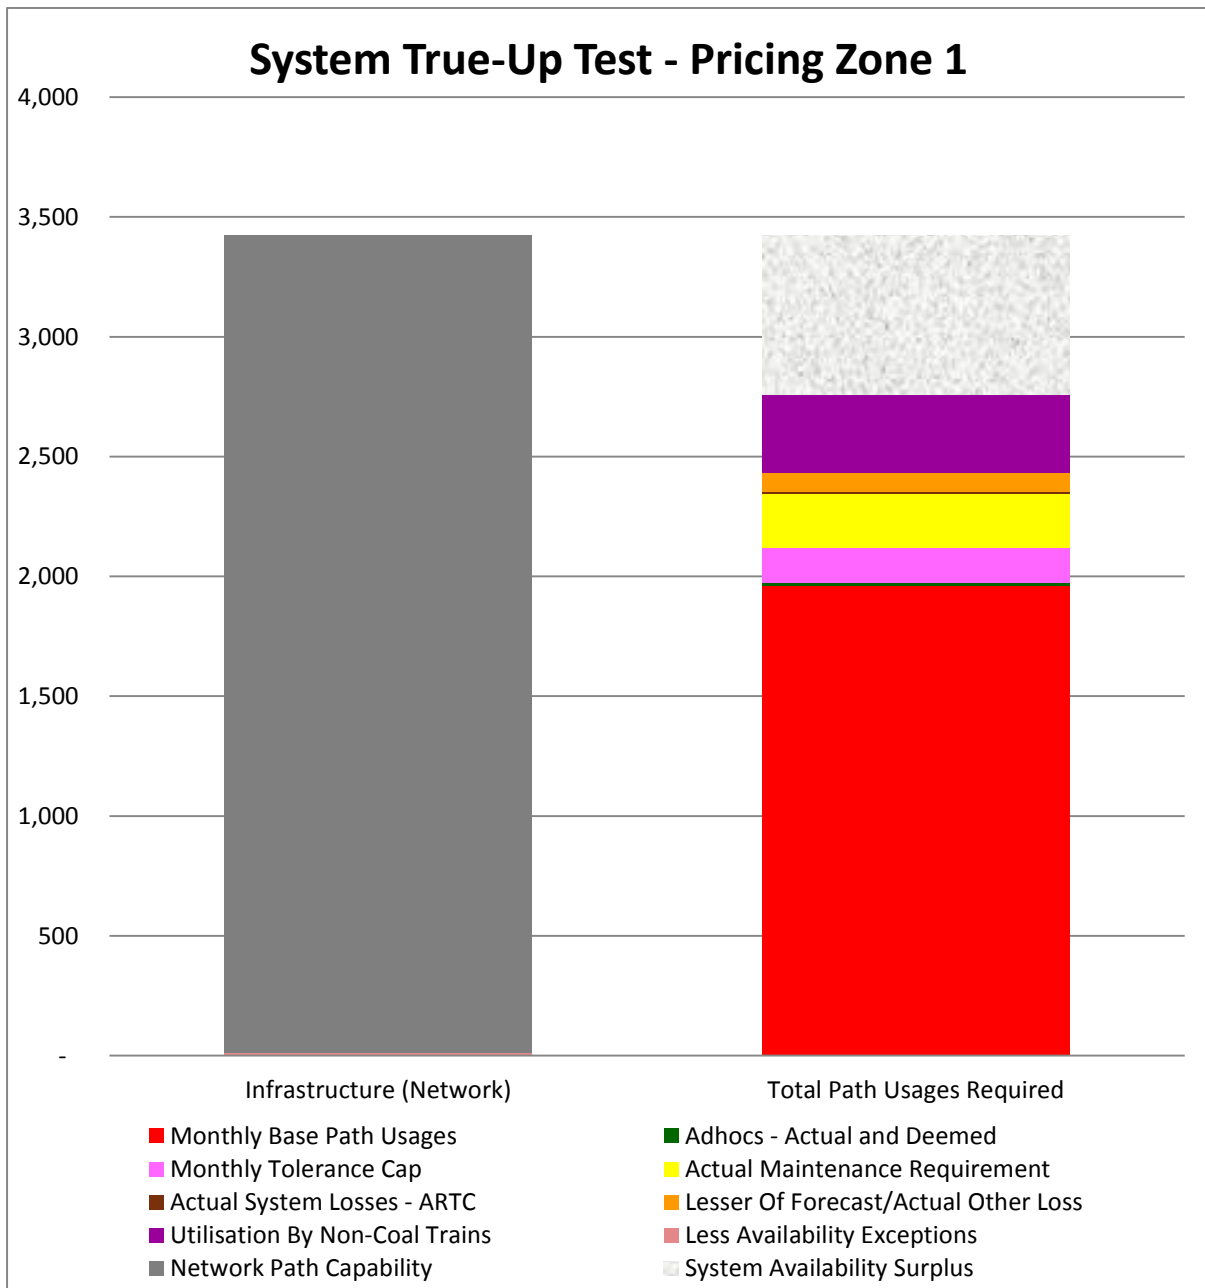


MONTHLY TRUE-UP TEST AUGUST 2014 RESULTS

The system true up test for each Pricing Zone for August has been withdrawn and re-published to correct an error. This update did not result in any System Availability Shortfall for the period.

Pricing Zone 2	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		392
Adhocs - Actual and Deemed		-
Monthly Tolerance Cap		40
Actual Maintenance Requirement		70
Actual System Losses - ARTC		8
Lesser Of Forecast/Actual Other Loss		23
Utilisation By Non-Coal Trains		23
Less Availability Exceptions	-	-
Network Path Capability	1,395	-
System Availability Surplus		839

System True-Up Test - Pricing Zone 2

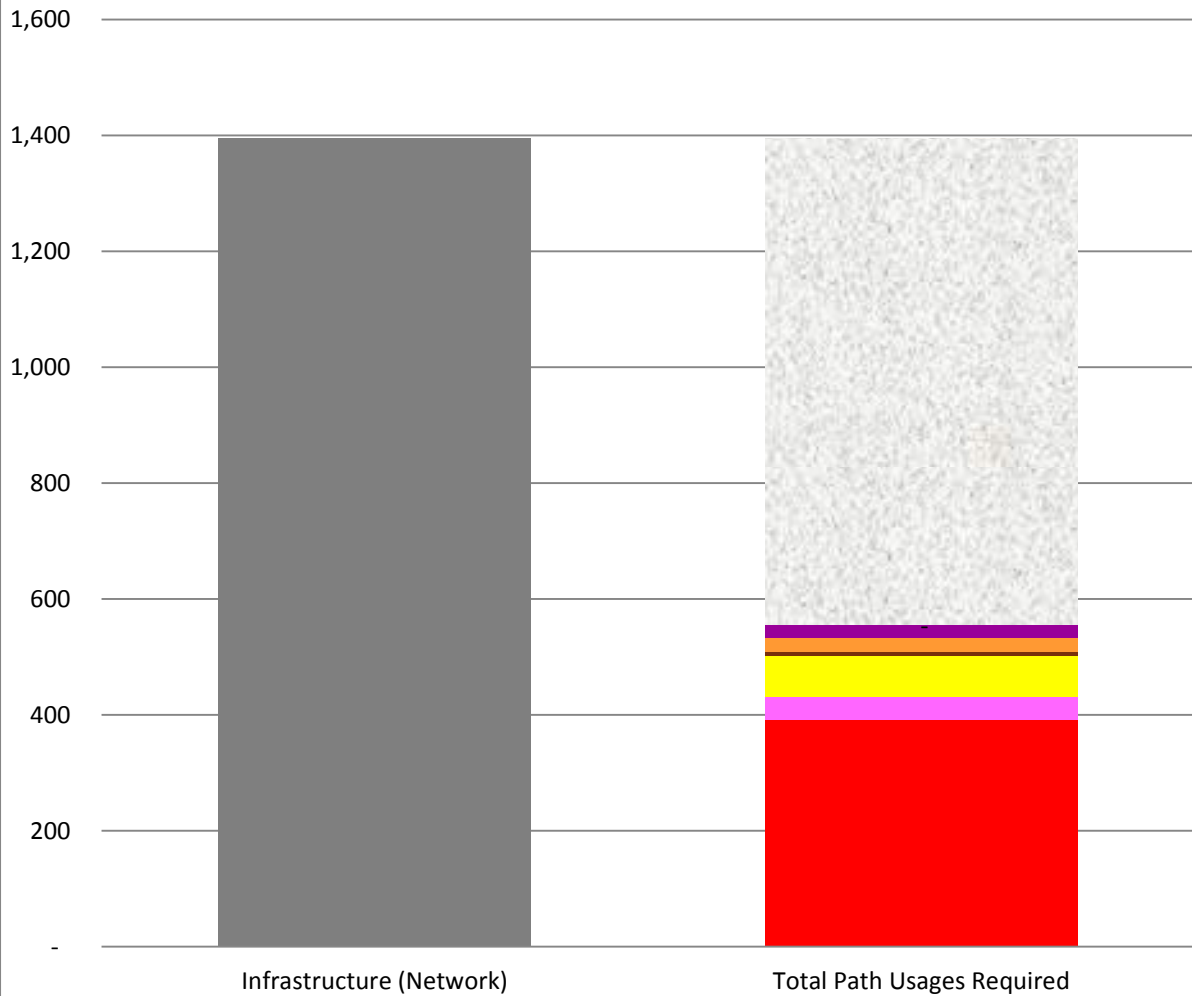

- Monthly Base Path Usages
- Monthly Tolerance Cap
- Actual System Losses - ARTC
- Utilisation By Non-Coal Trains
- Network Path Capability
- Adhocs - Actual and Deemed
- Actual Maintenance Requirement
- Lesser Of Forecast/Actual Other Loss
- Less Availability Exceptions
- System Availability Surplus

MONTHLY TRUE-UP TEST AUGUST 2014 RESULTS

The system true up test for each Pricing Zone for August has been withdrawn and re-published to correct an error. This update did not result in any System Availability Shortfall for the period.

ARTC considers publishing of system true-up test results for Pricing Zone 3 in aggregation will disclose confidential information about an individual access holder. In accordance with Clause 2.7(a) of Schedule 2 of Access Holder Agreements ARTC is not publishing Pricing Zone 3.

There is no System Availability Shortfall in Pricing Zone 3.