


**RE-ISSUE JUNE / MONTHLY & QUARTER 2
TRUE-UP TEST RESULTS**

The system True Up Test for Q2 2015 has been withdrawn and re-published to correct an error. The update did not result in any system availability shortfall for the period.

June 2015

Pricing Zone 1		
	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		2,056
Adhocs - Actual and Deemed		36
Monthly Tolerance Cap		184
Actual Maintenance Requirement		109
Actual System Losses - ARTC		15
Lesser Of Forecast/Actual Other Loss		83
Utilisation By Non-Coal Trains		54
Less Availability Exceptions	12	
Network Path Capability	3,630	
System Availability Surplus		1,105

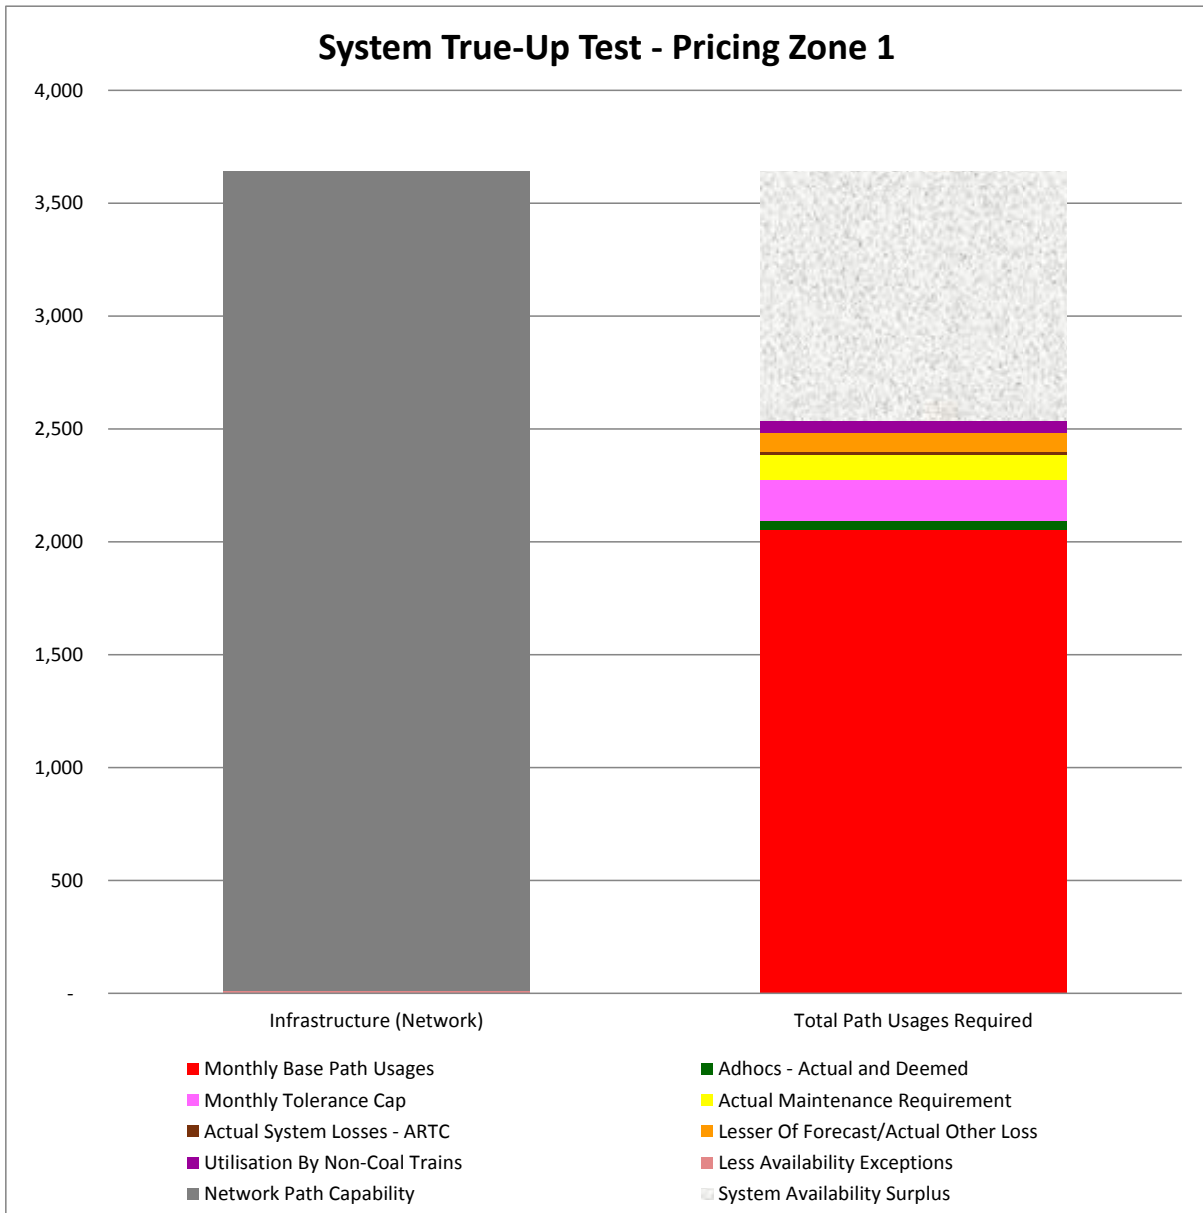


RE-ISSUE JUNE / MONTHLY & QUARTER 2

TRUE-UP TEST RESULTS

The system True Up Test for Q2 2015 has been withdrawn and re-published to correct an error. The update did not result in any system availability shortfall for the period.

June 2015

Pricing Zone 2		
	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		426
Adhocs - Actual and Deemed		-
Monthly Tolerance Cap		56
Actual Maintenance Requirement		-
Actual System Losses - ARTC		2
Lesser Of Forecast/Actual Other Loss		18
Utilisation By Non-Coal Trains		4
Less Availability Exceptions	3	
Network Path Capability	690	
System Availability Surplus		187

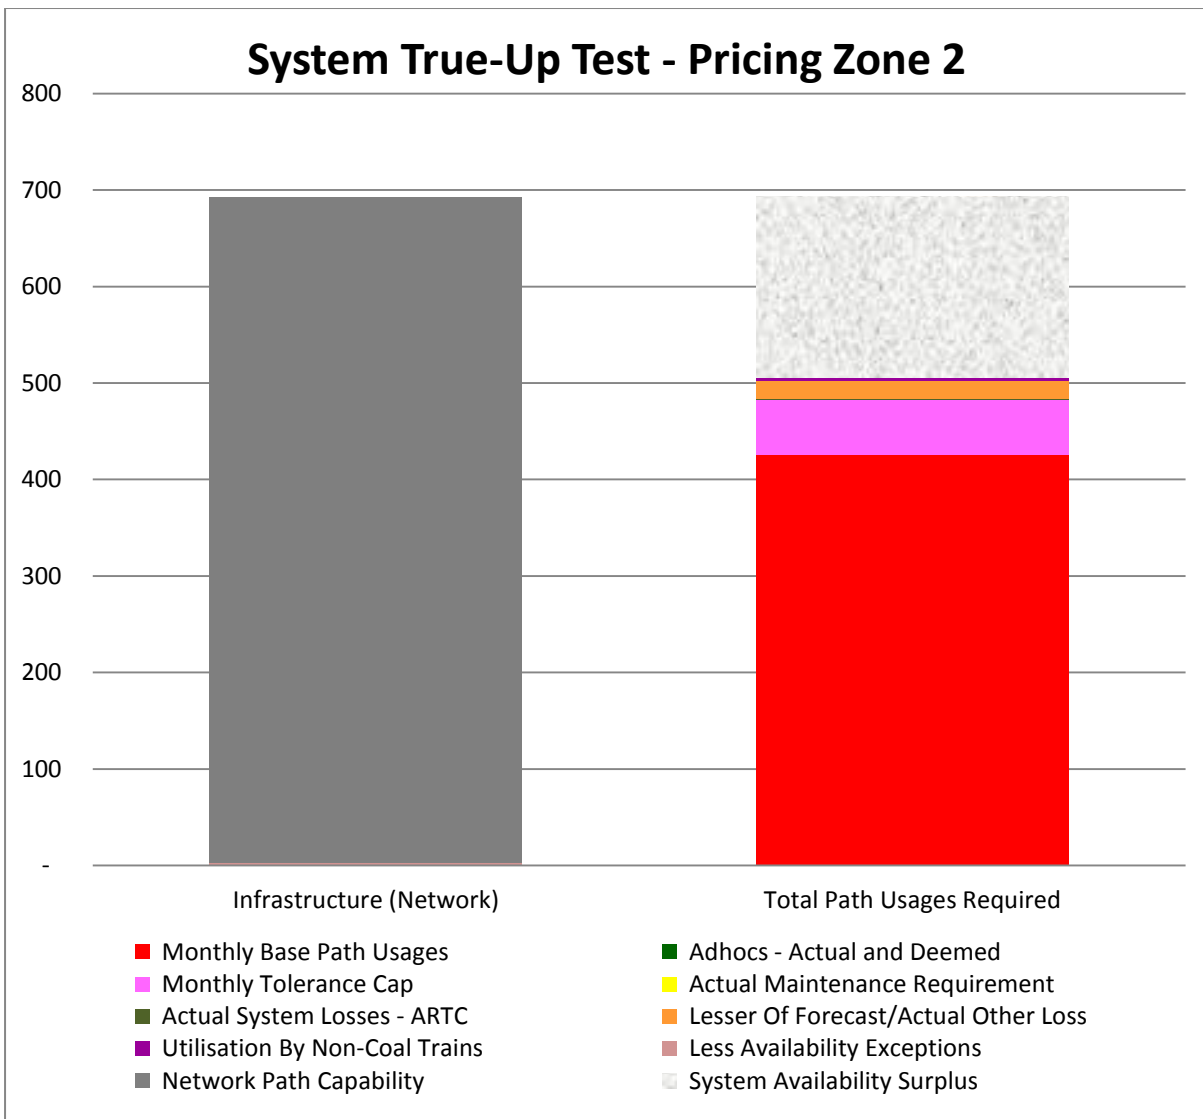


RE-ISSUE JUNE / MONTHLY & QUARTER 2

TRUE-UP TEST RESULTS

The system True Up Test for Q2 2015 has been withdrawn and re-published to correct an error. The update did not result in any system availability shortfall for the period.

Quarter 2

Pricing Zone 2		
	Infrastructure (Network)	Total Path Usages Required
Quarterly Base Path Usages		-
Adhocs - Actual and Deemed		1,069
Quarterly Tolerance Cap		168
Actual Maintenance Requirement		79
Actual System Losses - ARTC		8
Lesser Of Forecast/Actual Other Loss		81
Utilisation By Non-Coal Trains		45
Less Availability Exceptions	131	
Network Path Capability	2,093	
System Availability Surplus		774

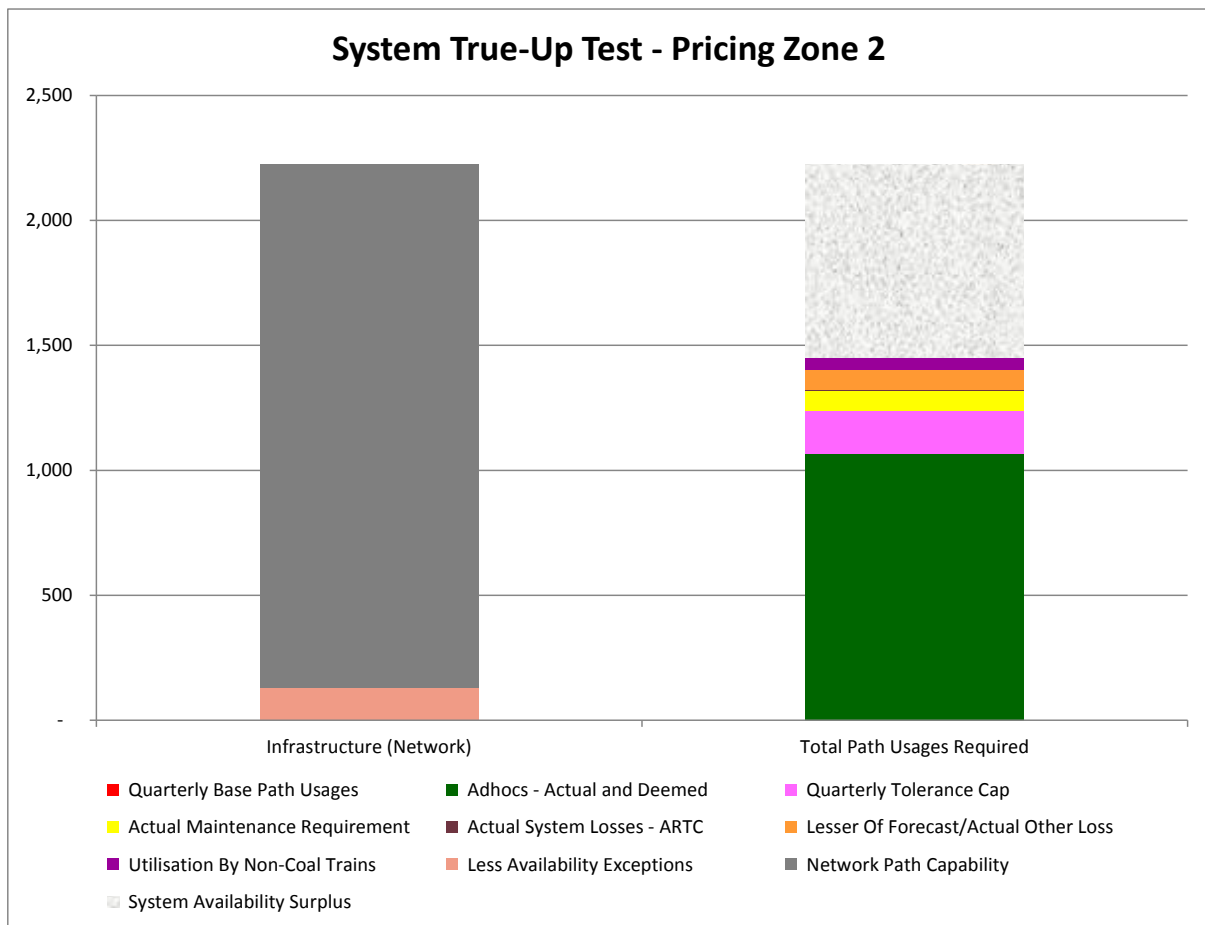

ARTC considers publishing of quarterly system true-up test results for Pricing Zone 1 and Pricing Zone 3 in aggregation will disclose confidential information about an individual access holder. In accordance with Clause 2.7(a) of Schedule 2 of Access Holder Agreements ARTC is not publishing quarterly system true-up test results.

There are no System Availability Shortfalls in Pricing Zone 1 or Pricing Zone 3.