



Pricing Zone 1	June	2018
	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		1,845
Adhocs - Actual and Deemed		93
Monthly Tolerance Cap		184
Actual Maintenance Requirement		546
Actual System Losses - ARTC		15
Lesser Of Forecast/Actual Other Loss		84
Utilisation By Non-Coal Trains		182
Less Availability Exceptions	4	
Network Path Capability	3,450	
System Availability Surplus		505

NB: ARTC confirms the 4 Availability Exceptions in Pricing Zone 1 in June were attributable to a severe weather event.

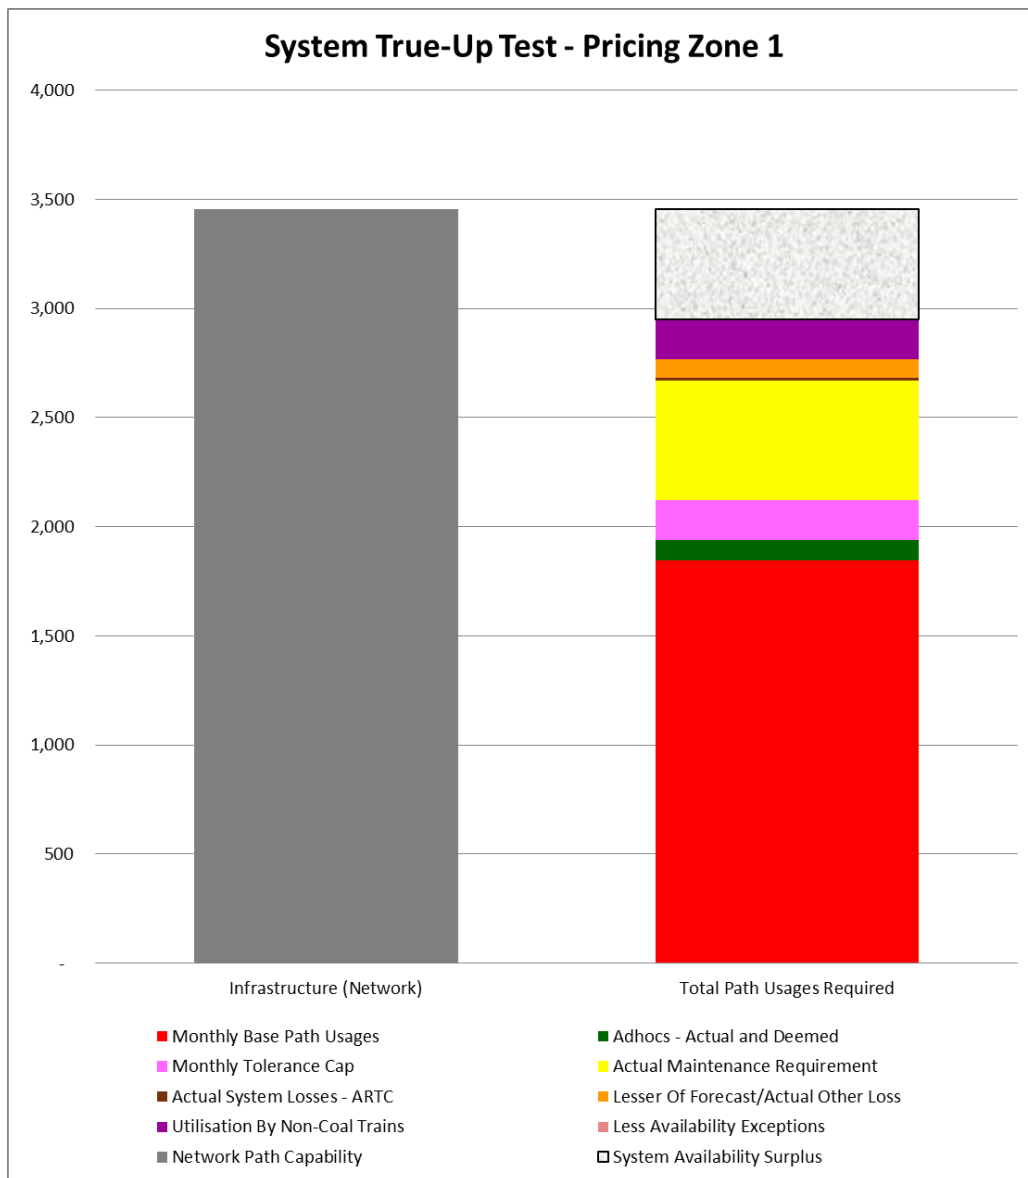


Pricing Zone 2	June	2018
	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		507
Adhocs - Actual and Deemed		13
Monthly Tolerance Cap		61
Actual Maintenance Requirement		79
Actual System Losses - ARTC		15
Lesser Of Forecast/Actual Other Loss		45
Utilisation By Non-Coal Trains		27
Less Availability Exceptions	2	
Network Path Capability	780	
System Availability Surplus		35

NB: ARTC confirms the 2 Availability Exceptions in Pricing Zone 2 in June were attributable to a severe weather event.

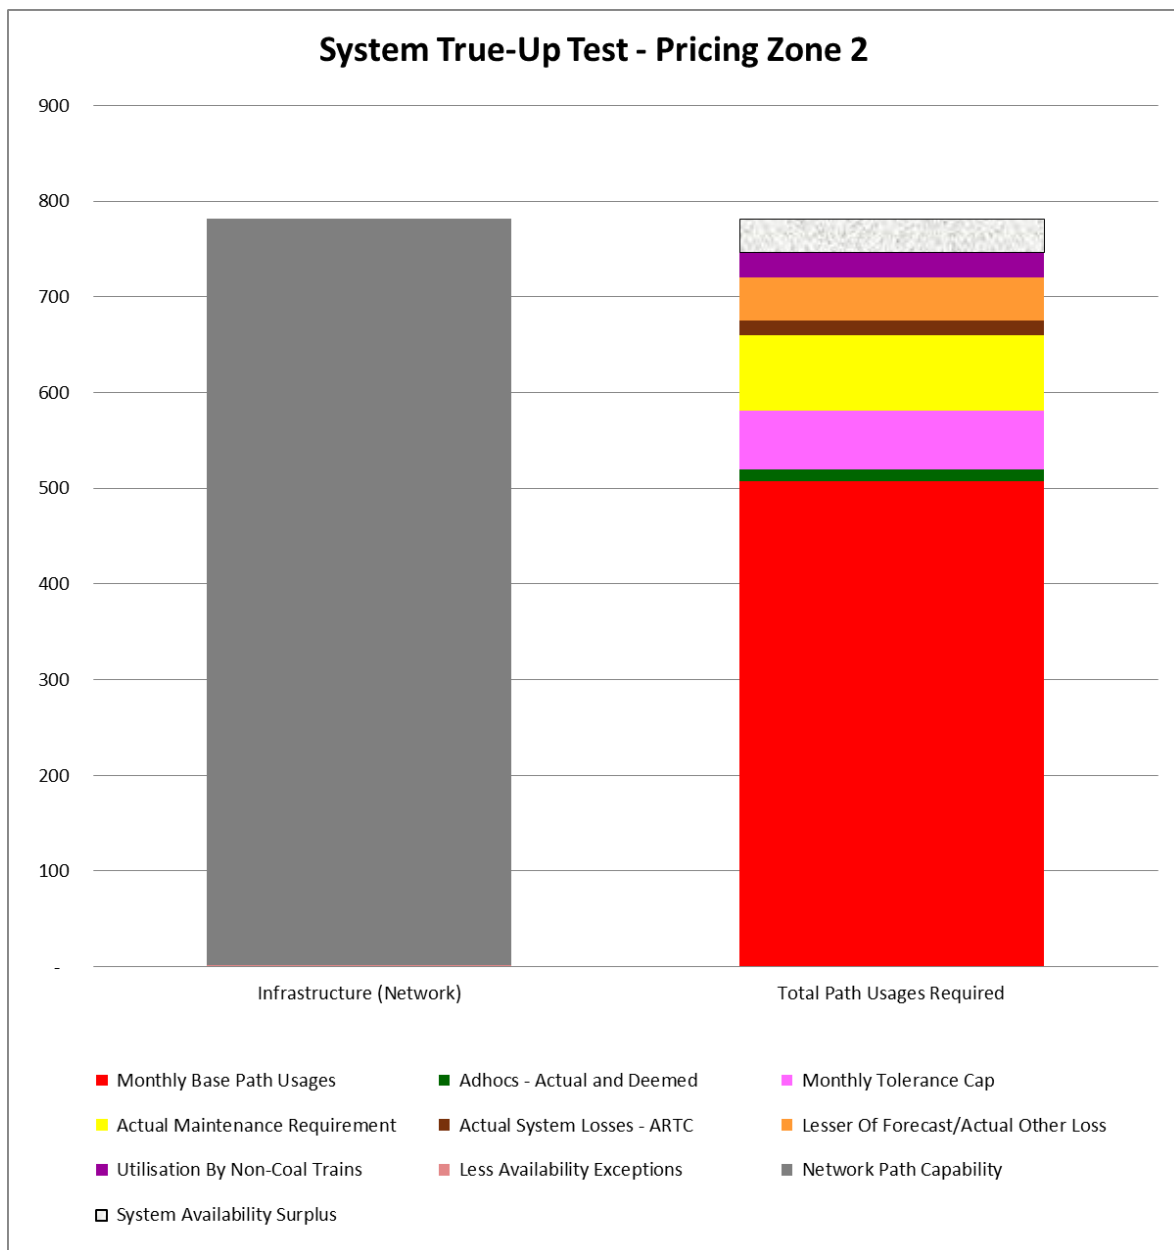

ARTC considers publishing of system true-up test results for Pricing Zone 3 in aggregation will disclose confidential information about an individual access holder. In accordance with Clause 2.7(a) of Schedule 2 of Access Holder Agreements ARTC is not publishing Pricing Zone 3. There is no System Availability Shortfall in Pricing Zone 3.

Pricing Zone 2	Quarter 2	2018
	Infrastructure (Network)	Total Path Usages Required
Quarterly Base Path Usages		-
Adhocs - Actual and Deemed		1,465
Quarterly Tolerance Cap		183
Actual Maintenance Requirement		172
Actual System Losses - ARTC		35
Lesser Of Forecast/Actual Other Loss		142
Utilisation By Non-Coal Trains		82
Less Availability Exceptions	3	
Network Path Capability	2,366	
System Availability Surplus		290

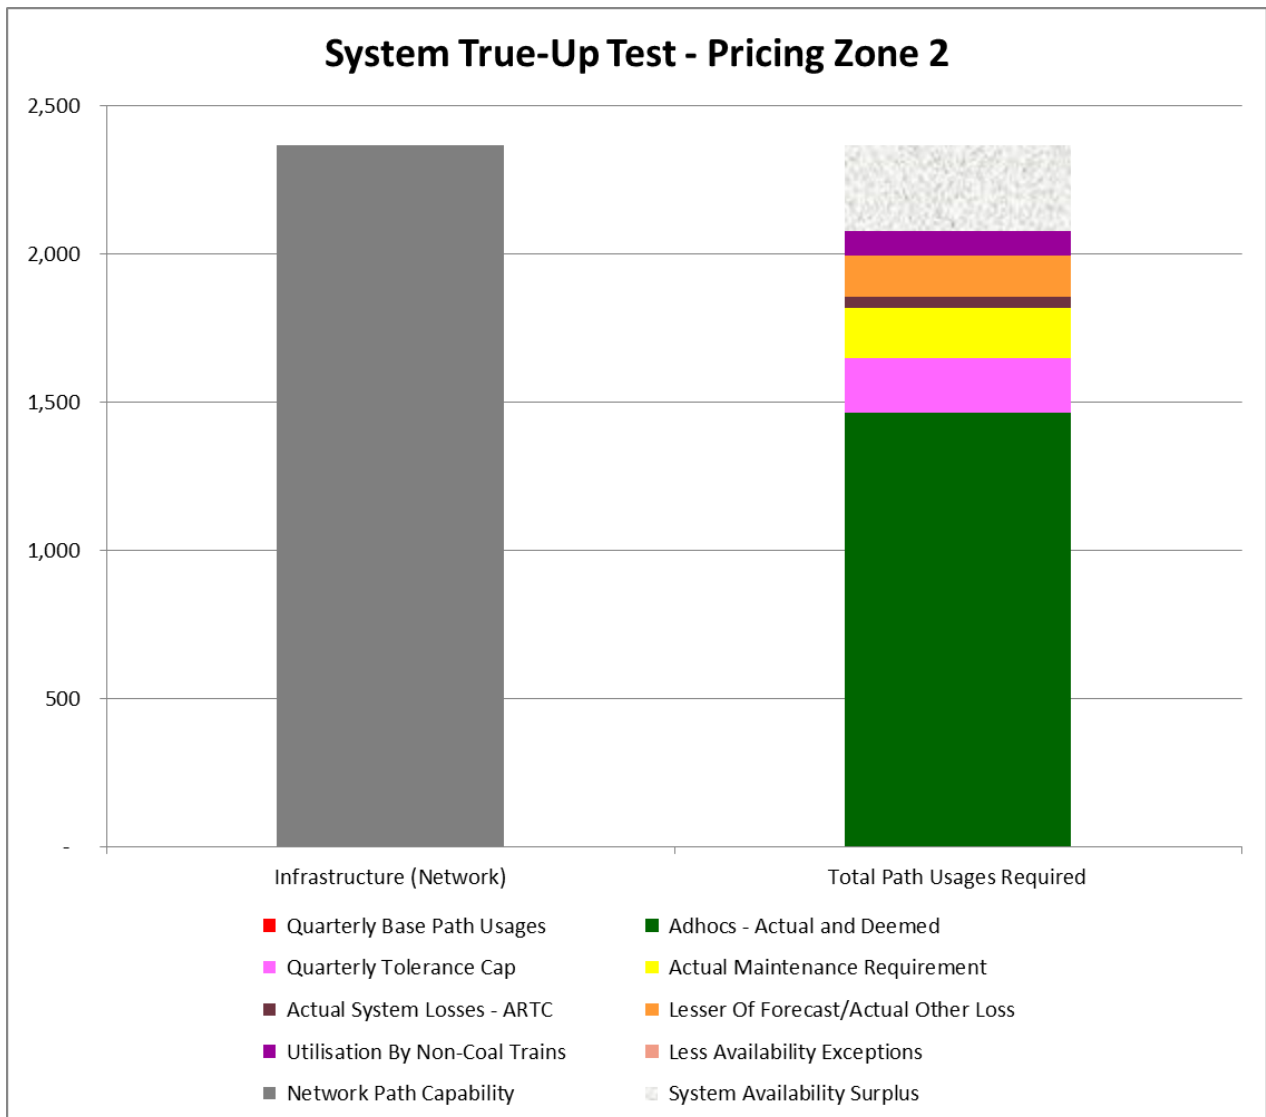

ARTC considers publishing of quarterly system true-up test results for Pricing Zone 1 and Pricing Zone 3 in aggregation will disclose confidential information about an individual access holder. In accordance with Clause 2.7(a) of Schedule 2 of Access Holder Agreements ARTC is not publishing quarterly system true-up test results.

There is no System Availability Shortfall in Pricing Zone 1 and 3.