



Pricing Zone 1	March	2018
	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		2,134
Adhocs - Actual and Deemed		50
Monthly Tolerance Cap		184
Actual Maintenance Requirement		254
Actual System Losses - ARTC		12
Lesser Of Forecast/Actual Other Loss		97
Utilisation By Non-Coal Trains		206
Less Availability Exceptions	26	
Network Path Capability	3,565	
System Availability Surplus		654

NB: ARTC confirms the 26 Availability Exceptions in Pricing Zone 3 in March were attributable to a severe weather event and a trespassing event.

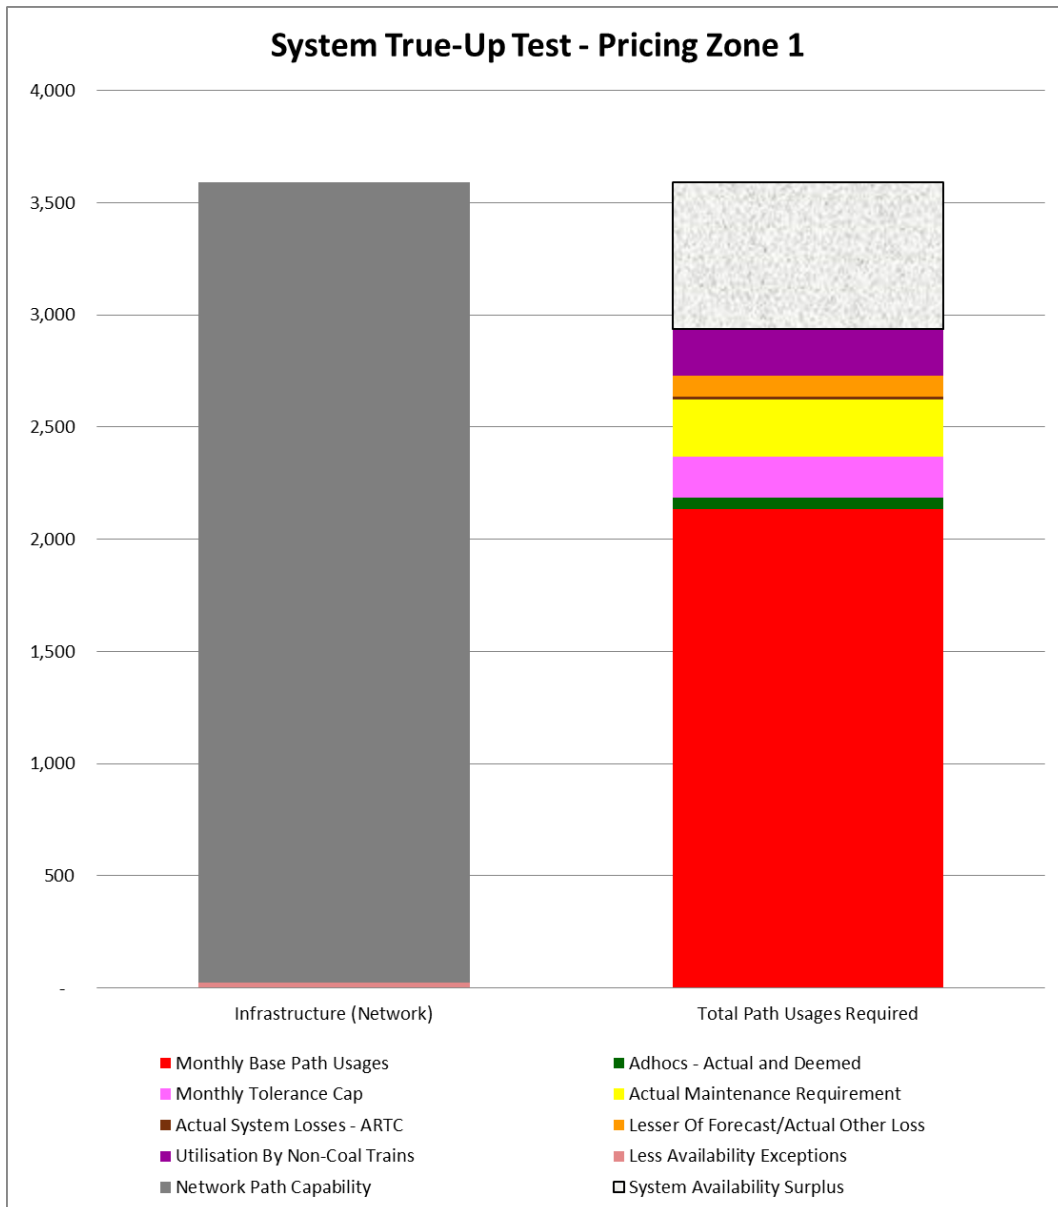


Pricing Zone 2	March	2018
	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		585
Adhocs - Actual and Deemed		16
Monthly Tolerance Cap		61
Actual Maintenance Requirement		39
Actual System Losses - ARTC		6
Lesser Of Forecast/Actual Other Loss		50
Utilisation By Non-Coal Trains		22
Less Availability Exceptions	17	
Network Path Capability	806	
System Availability Surplus		44

NB: ARTC confirms the 17 Availability Exceptions in Pricing Zone 3 in March were attributable to a severe weather event.

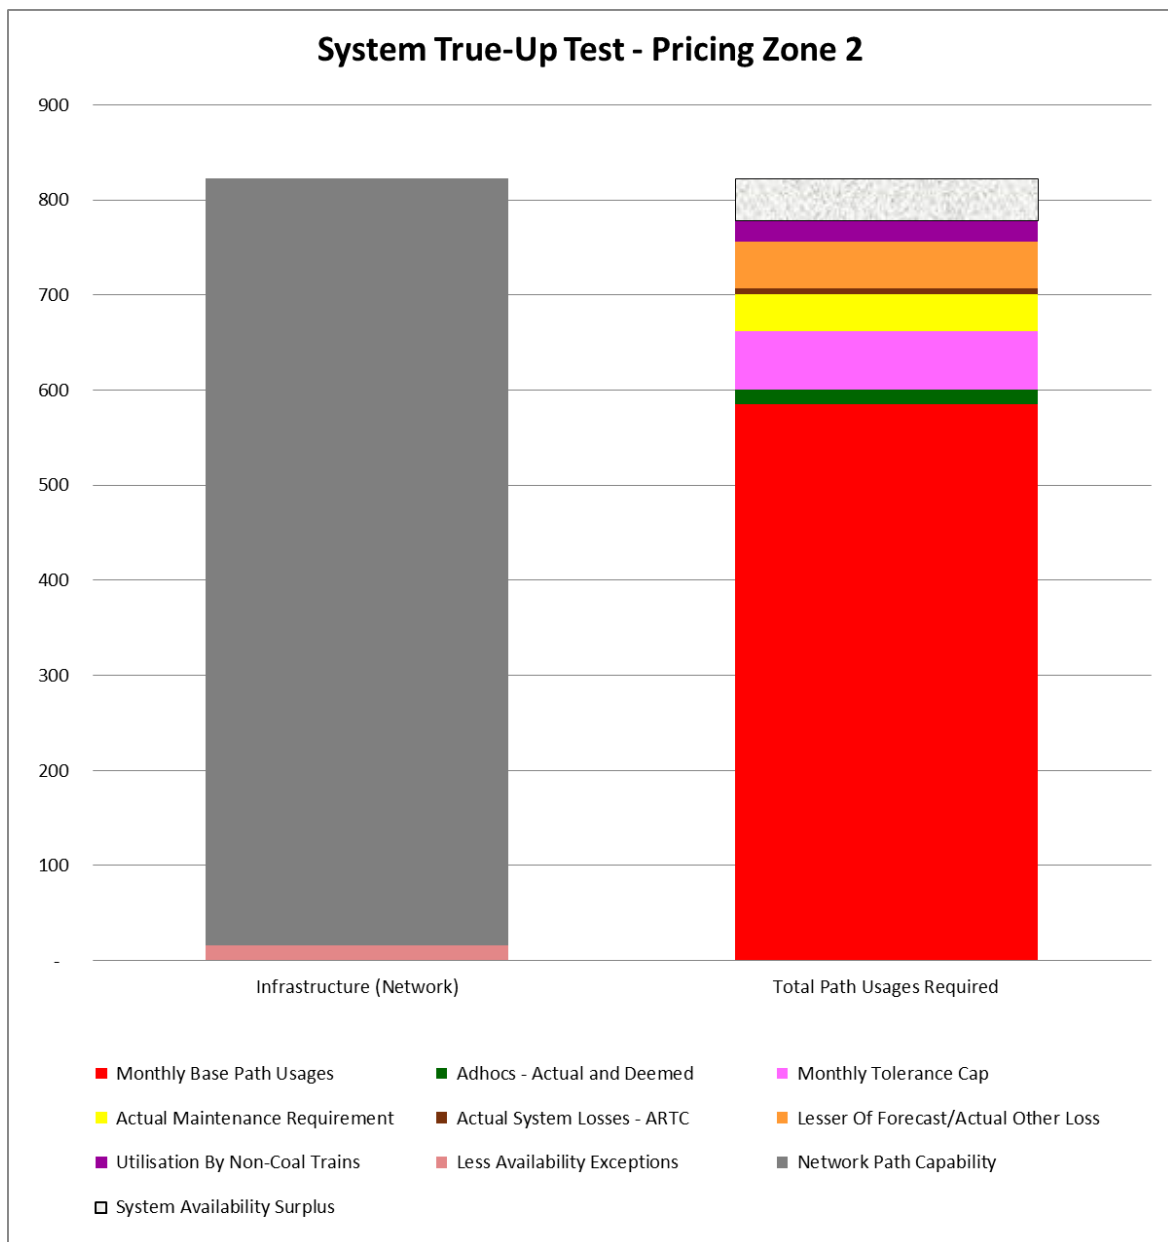

ARTC considers publishing of system true-up test results for Pricing Zone 3 in aggregation will disclose confidential information about an individual access holder. In accordance with Clause 2.7(a) of Schedule 2 of Access Holder Agreements ARTC is not publishing Pricing Zone 3. There is no System Availability Shortfall in Pricing Zone 3.

Pricing Zone 2	Quarter 1	2018
	Infrastructure (Network)	Total Path Usages Required
Quarterly Base Path Usages		-
Adhocs - Actual and Deemed		1,348
Quarterly Tolerance Cap		183
Actual Maintenance Requirement		178
Actual System Losses - ARTC		24
Lesser Of Forecast/Actual Other Loss		144
Utilisation By Non-Coal Trains		64
Less Availability Exceptions	21	
Network Path Capability	2,340	
System Availability Surplus		420

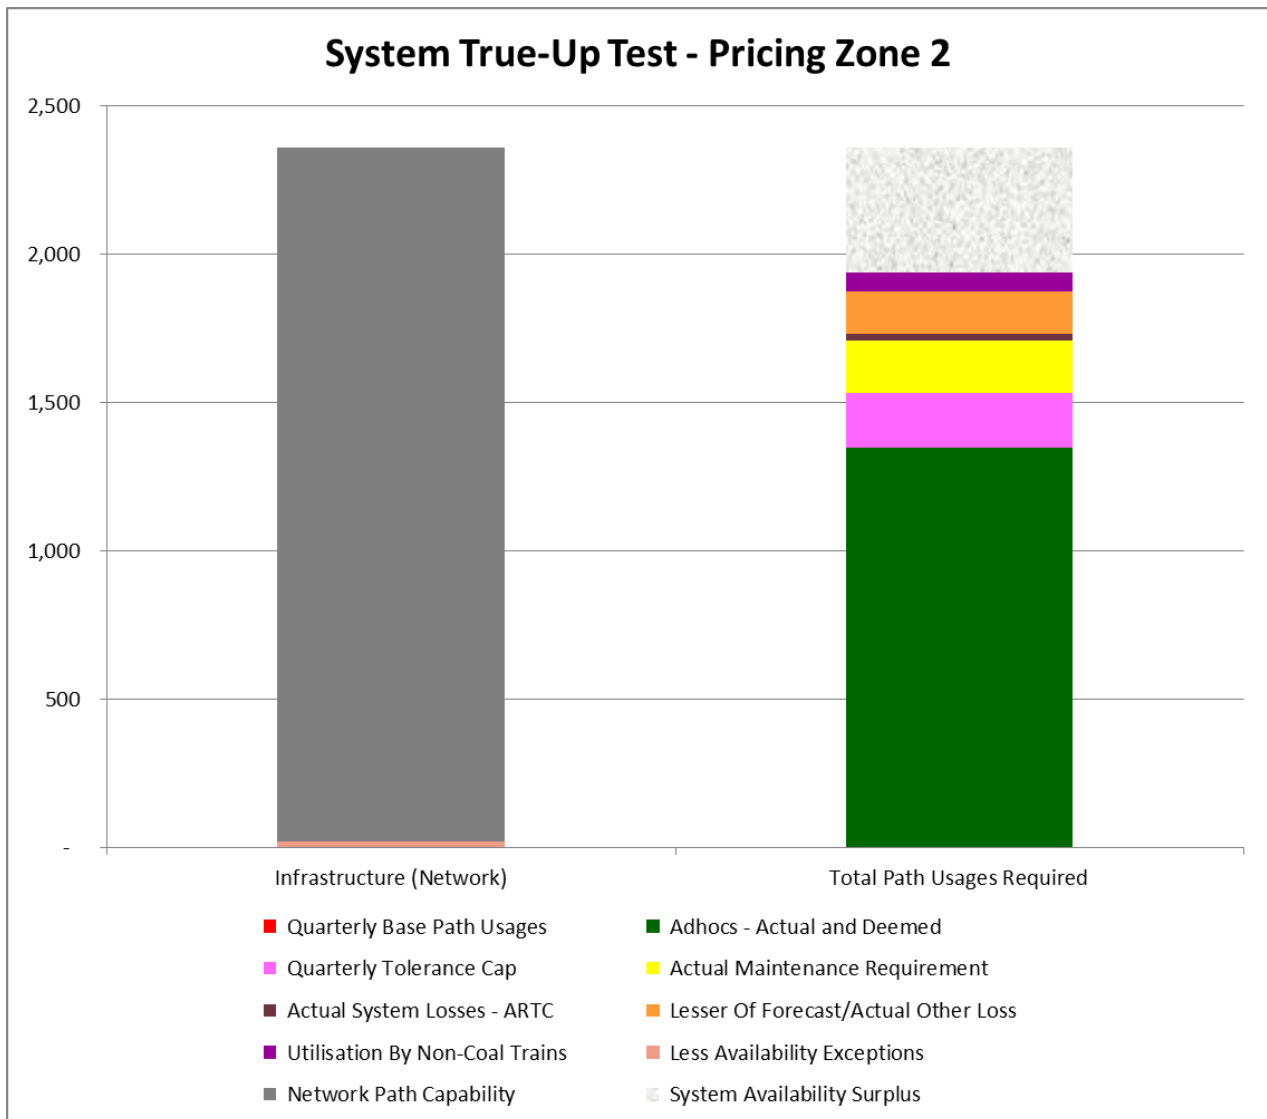

ARTC considers publishing of quarterly system true-up test results for Pricing Zone 1 and Pricing Zone 3 in aggregation will disclose confidential information about an individual access holder. In accordance with Clause 2.7(a) of Schedule 2 of Access Holder Agreements ARTC is not publishing quarterly system true-up test results.

There is no System Availability Shortfall in Pricing Zone 1 and 3.