


MONTHLY TRUE-UP TEST SEPTEMBER 2014 RESULTS


Pricing Zone 1		
	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		1,851
Adhocs - Actual and Deemed		39
Monthly Tolerance Cap		150
Actual Maintenance Requirement		198
Actual System Losses - ARTC		26
Lesser Of Forecast/Actual Other Loss		95
Utilisation By Non-Coal Trains		298
Less Availability Exceptions	2	-
Network Path Capability	3,300	-
System Availability Surplus		645

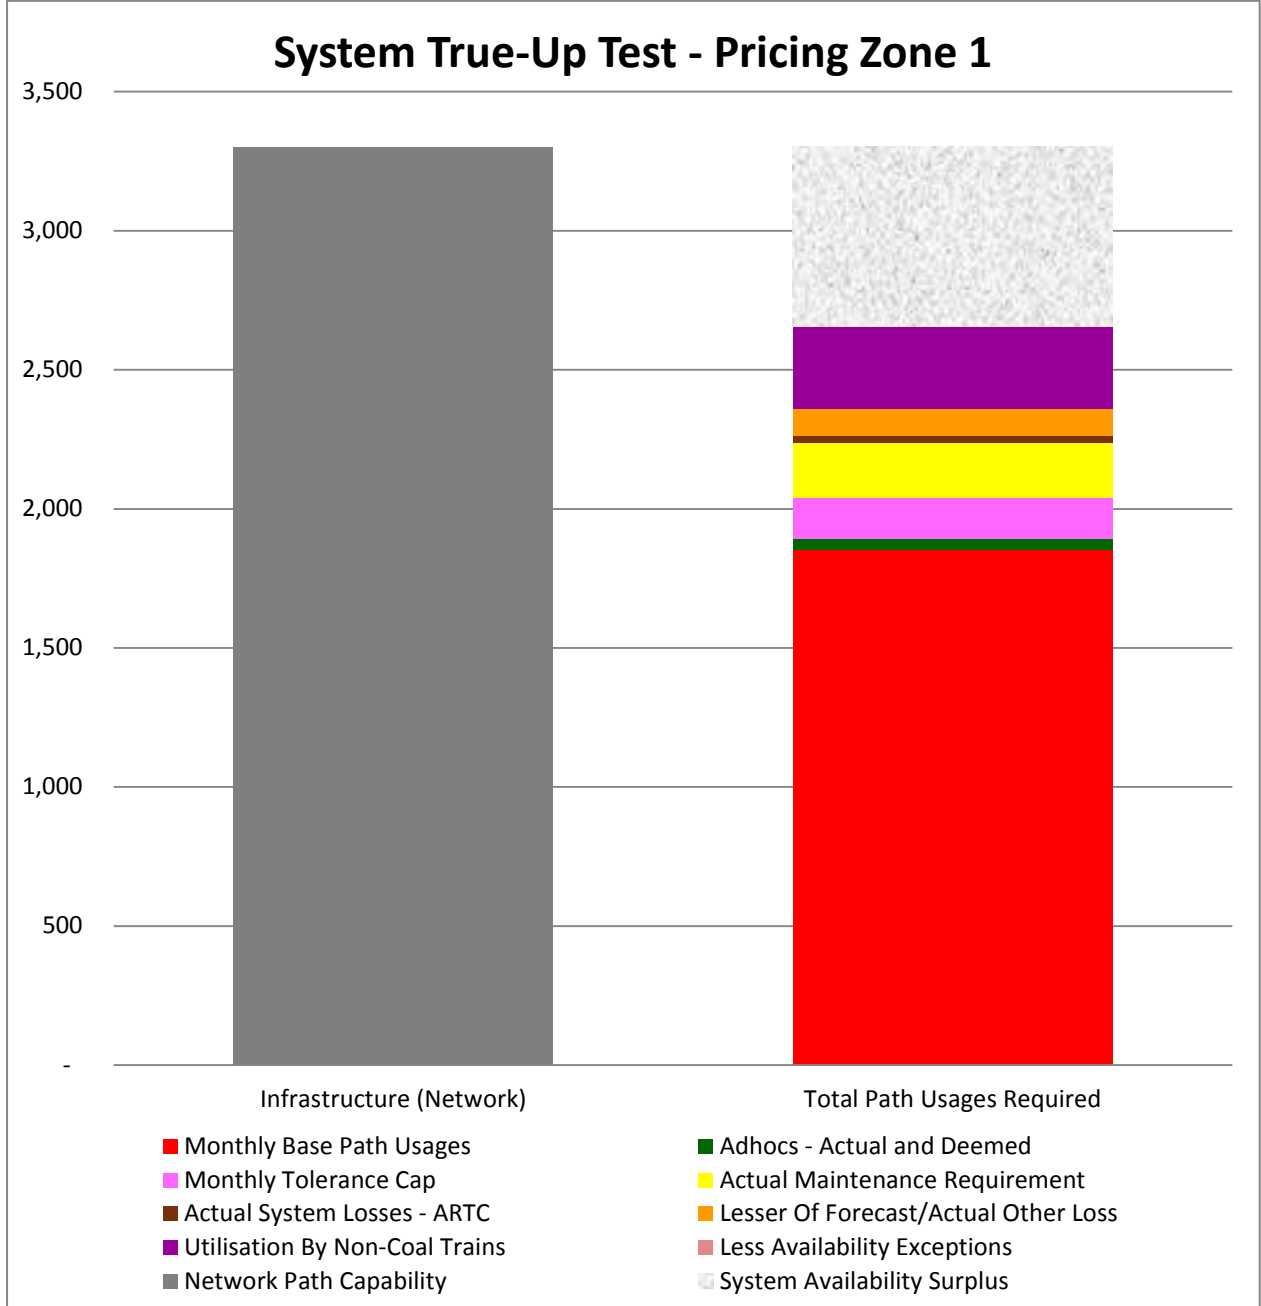

MONTHLY TRUE-UP TEST SEPTEMBER 2014 RESULTS

Pricing Zone 2		
	Infrastructure (Network)	Total Path Usages Required
Monthly Base Path Usages		373
Adhocs - Actual and Deemed		7
Monthly Tolerance Cap		40
Actual Maintenance Requirement		68
Actual System Losses - ARTC		5
Lesser Of Forecast/Actual Other Loss		38
Utilisation By Non-Coal Trains		17
Less Availability Exceptions	1	-
Network Path Capability	1,350	-
System Availability Surplus		804

System True-Up Test - Pricing Zone 2

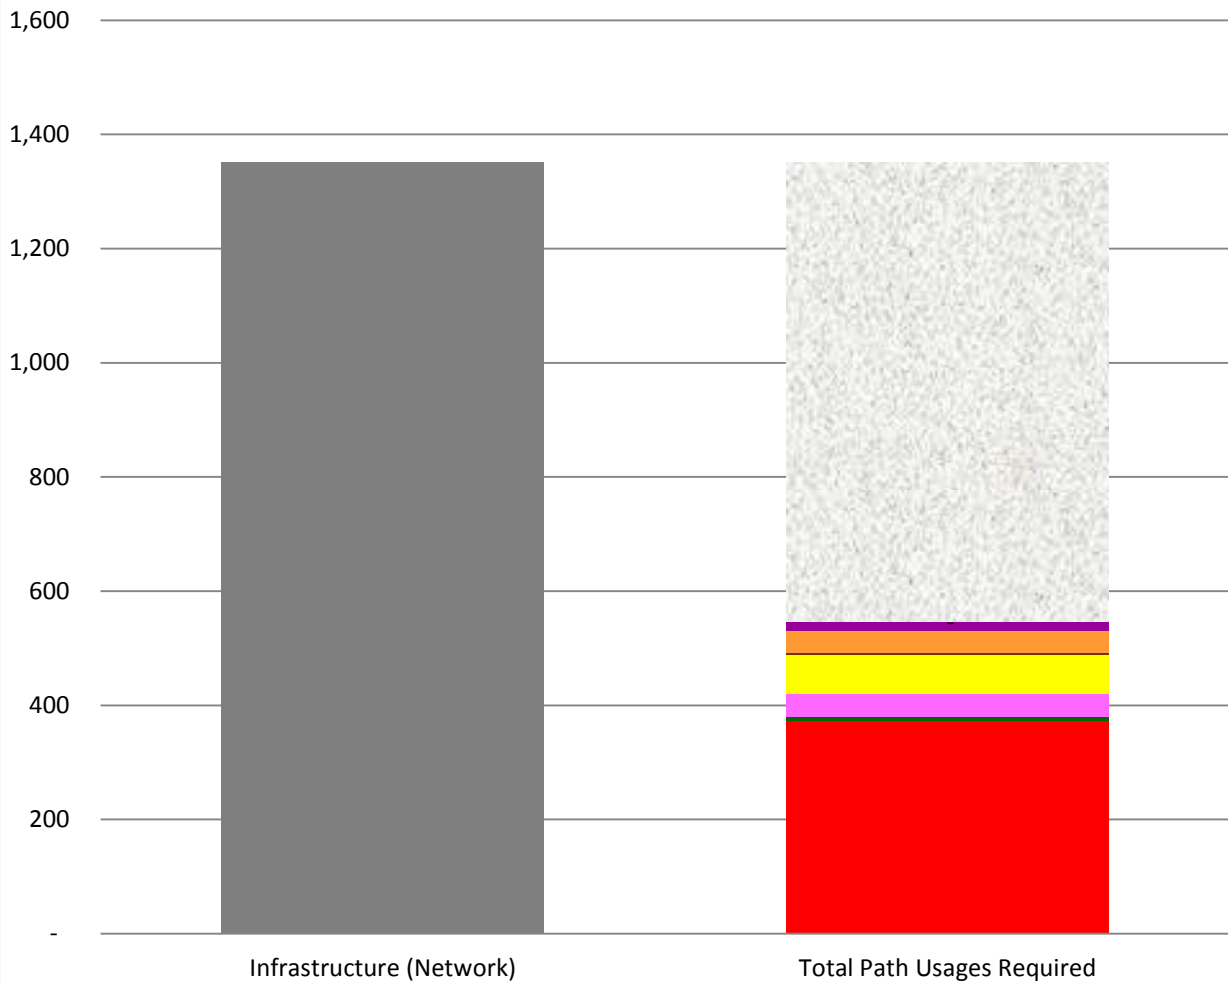

- Monthly Base Path Usages
- Adhocs - Actual and Deemed
- Monthly Tolerance Cap
- Actual Maintenance Requirement
- Actual System Losses - ARTC
- Lesser Of Forecast/Actual Other Loss
- Utilisation By Non-Coal Trains
- Less Availability Exceptions
- Network Path Capability
- System Availability Surplus


MONTHLY TRUE-UP TEST SEPTEMBER 2014 RESULTS

ARTC considers publishing of system true-up test results for Pricing Zone 3 in aggregation will disclose confidential information about an individual access holder. In accordance with Clause 2.7(a) of Schedule 2 of Access Holder Agreements ARTC is not publishing Pricing Zone 3.

There is no System Availability Shortfall in Pricing Zone 3.

QUARTERLY TRUE-UP TEST SEPTEMBER 2014 RESULTS

Pricing Zone 2		
	Infrastructure (Network)	Total Path Usages Required
Quarterly Base Path Usages		-
Adhocs - Actual and Deemed		1,094
Quarterly Tolerance Cap		120
Actual Maintenance Requirement		207
Actual System Losses - ARTC		19
Lesser Of Forecast/Actual Other Loss		74
Utilisation By Non-Coal Trains		59
Less Availability Exceptions	1	
Network Path Capability	4,140	
System Availability Surplus		2,568

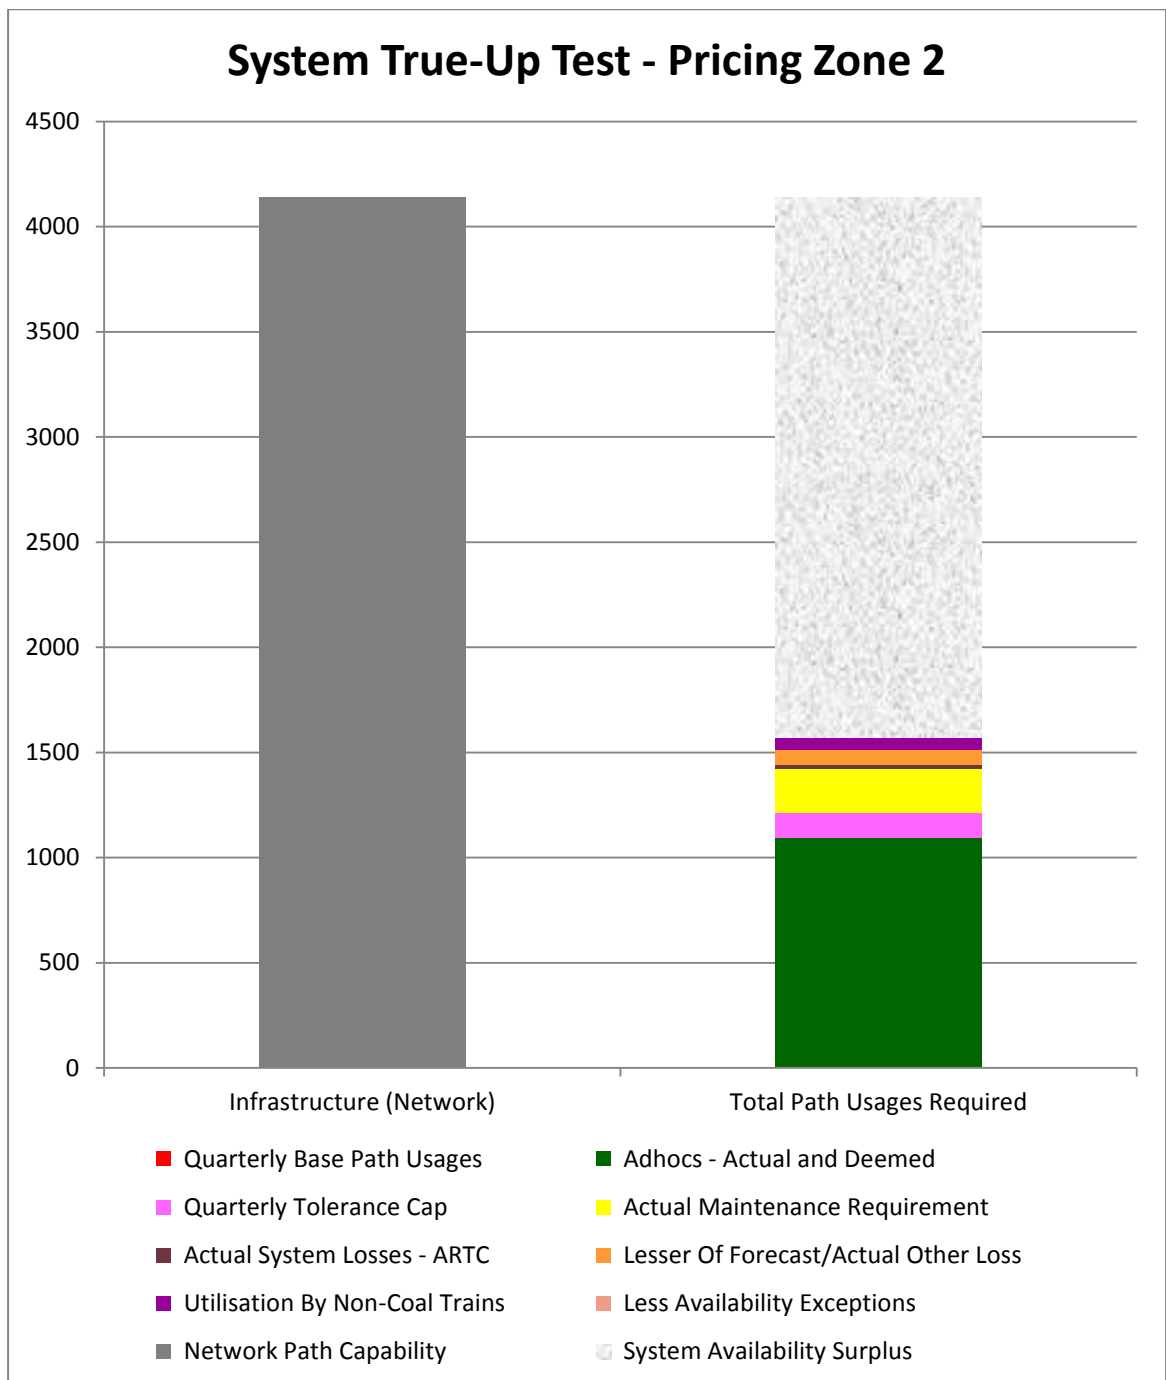

QUARTERLY TRUE-UP TEST SEPTEMBER 2014 RESULTS

ARTC considers publishing of quarterly system true-up test results for Pricing Zone 1 and Pricing Zone 3 in aggregation will disclose confidential information about an individual access holder. In accordance with Clause 2.7(a) of Schedule 2 of Access Holder Agreements ARTC is not publishing quarterly system true-up test results.

There is no System Availability Shortfall in Pricing Zone 1 or Pricing Zone 3.